

PHOTOGRAPH #1



**BUILDING 12
SECTION A**

Painting completed.

PHOTOGRAPH #2



**BUILDING 12
SECTION B**

Painting completed.

PHOTOGRAPH #3



**BUILDING 12
SECTION C**

Painting completed.

PHOTOGRAPH #4



**BUILDING 12
SECTION D**

Painting completed.

PHOTOGRAPH #5



**BUILDING 15
SECTION H**

Demolition of existing stucco and sheathing in progress.

PHOTOGRAPH #6



**BUILDING 15
SECTION G**

Demolition of existing stucco and sheathing in progress.

PHOTOGRAPH #7



**BUILDING 15
SECTION F**

Demolition of existing stucco and sheathing in progress.

PHOTOGRAPH #8



**BUILDING 15
SECTION E**

Demolition of existing stucco and sheathing in progress.

PHOTOGRAPH #9



**BUILDING 9
SECTION H**

Installation of stucco lath and accessories completed.

PHOTOGRAPH #10



**BUILDING 9
SECTION H**

Hole found in stucco lath and vapor barrier.

PHOTOGRAPH #11



**BUILDING 9
SECTION H**

Hole found in stucco lath and vapor barrier.

PHOTOGRAPH #12



**BUILDING 9
SECTION H**

Hole found in stucco lath and vapor barrier.

PHOTOGRAPH #13



**BUILDING 9
SECTION G**

Installation of stucco lath and accessories in progress.


PHOTOGRAPH #14



**BUILDING 9
SECTION F**

Installation of Super Jumbo Tex Weather-Resistive Barrier and stucco accessories completed.

PHOTOGRAPH #15

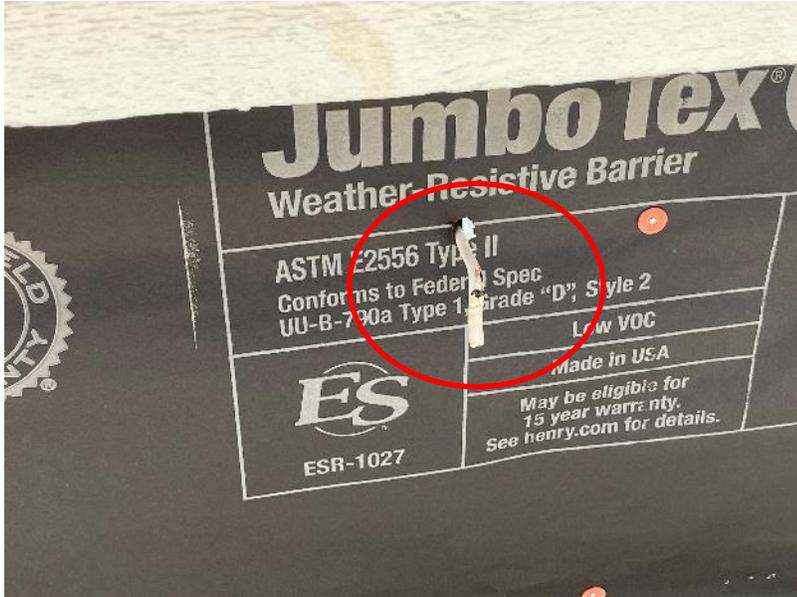

**BUILDING 9
SECTION F**

Penetration found in weather barrier.

PHOTOGRAPH #16



**BUILDING 9
SECTION D**

Contractor installing 15/32 exterior rated plywood sheathing fastened with 0.113" x 2-3/8" electro galvanized ring shank nails at 4" O.C. along panel edges 6" O.C. in field.


PHOTOGRAPH #17



**BUILDING 9
SECTION D**

Contractor installing 15/32 exterior rated plywood sheathing fastened with 0.113" x 2-3/8" electro galvanized ring shank nails at 4" O.C. along panel edges 6" O.C. in field.

PHOTOGRAPH #18

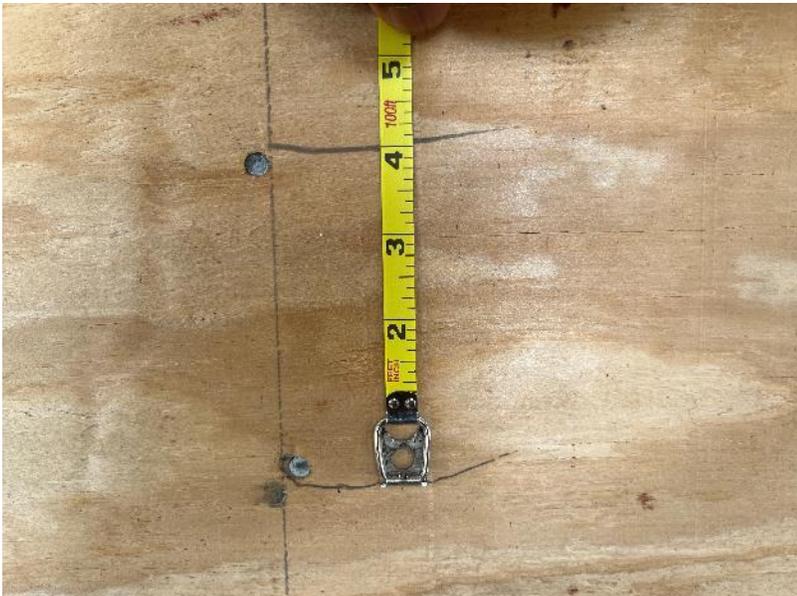

**BUILDING 9
SECTION D**

Contractor installing 15/32 exterior rated plywood sheathing fastened with 0.113" x 2-3/8" electro galvanized ring shank nails at 4" O.C. along panel edges 6" O.C. in field.

PHOTOGRAPH #19



**BUILDING 9
SECTION D**

Plywood sheathing fastened with 0.113" x 2-3/8" electro galvanized ring shank nails.

PHOTOGRAPH #20



**BUILDING 9
SECTION C**

Contractor installing 15/32 exterior rated plywood sheathing fastened with 0.113" x 2-3/8" electro galvanized ring shank nails at 4" O.C. along panel edges 6" O.C. in field.

PHOTOGRAPH #21



**BUILDING 9
SECTION C**

Contractor installing 15/32 exterior rated plywood sheathing fastened with 0.113" x 2-3/8" electro galvanized ring shank nails at 4" O.C. along panel edges 6" O.C. in field.

PHOTOGRAPH #22



**BUILDING 9
SECTION C**

Overdriven nails were observed. Contractor to ensure nails are flushed with sheathing.

PHOTOGRAPH #23



**BUILDING 9
SECTION B**

Nailing of strapping completed and installation of plywood sheathing in progress.

PHOTOGRAPH #24



**BUILDING 9
SECTION B**

Nailing of strapping completed.

PHOTOGRAPH #25



**BUILDING 9
SECTION B**

Nailing of strapping completed.

PHOTOGRAPH #26



**BUILDING 9
SECTION B**

Contractor installing 15/32 exterior rated plywood sheathing fastened with 0.113" x 2-3/8" electro galvanized ring shank nails at 4" O.C. along panel edges 6" O.C. in field.